


Glass clamp
 A = Max. 15"
 B = Max. 10"

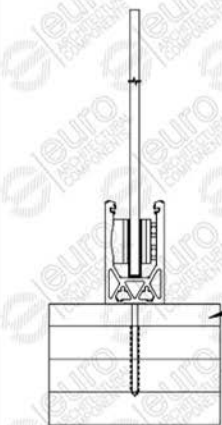

Triple 2" x 6",
 and, $\frac{5}{4}$ " deck board
 (Pressure treated lumber)
 securely fastened to the
 test frame

GENERAL NOTES:

- 1) THE LOAD RESISTANCE OF THE GLASS AND SPIGOT COMPONENTS INSTALLED IN THE CONFIGURATIONS AS SHOWN MEET THE LOAD REQUIREMENTS SPECIFIED IN SECTIONS 9.8.8.2 AND 4.1.5.14.1 (c) OF THE 2015 NBC AND THE 2012 OBC.
- 2) GLASS THICKNESS IS 1/2" OR 12 MM, AND MUST BE TEMPERED OR LAMINATED SAFETY GLASS INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF CAN/CGSB-12.1-M.
- 3) CERTIFICATION IS FOR GUARD COMPONENTS ONLY. FASTENING THE SPIGOT TO THE SUPPORT STRUCTURE IS A SITE CONDITION AND THE INSTALLERS MUST ENSURE THAT THE FASTENERS ARE ADEQUATE TO RESIST THE DESIGN LOADS.
- 4) THE MATERIAL TO WHICH THE GLASS SUPPORTS ARE BEING FASTENED MUST ADEQUATELY RESIST THE DESIGN LOADS.

Fasteners used for testing:

On concrete:

- Wedge anchor 1/2" x 4-1/4"

On wood:

- Lag bolt 1/2" x 5"
- 1/2" dia. thru-bolt or, threaded rod with flat washers and nuts (optional)



FINISH	CODE (10 ft.)	CODE (20 ft.)
SS Satin	SSSM3SHOE10S	SSSM3SHOE20S
Brush Anodized Al.	SSSM3SHOE10A	SSSM3SHOE20A



127A Aviva Park Dr.,
 Woodbridge, ON, CANADA
 www.euroeac.com
 Toll Free: 1-800-465-7143

TITLE: Base Shoe Moulding-Tilt Adjustable
 Top Mount

DATE: 05/24/2018
 SHEET: 1 of 1
 REV: 01